

Report Parameters

From: 19/10/2012 to 19/10/2012


Customer: DET NSSP

NMI(s): 4103795744

1708 Wisemans Ferry Rd, Central Mangrove

Meter(s): AMO002446

Time Zone: AEST

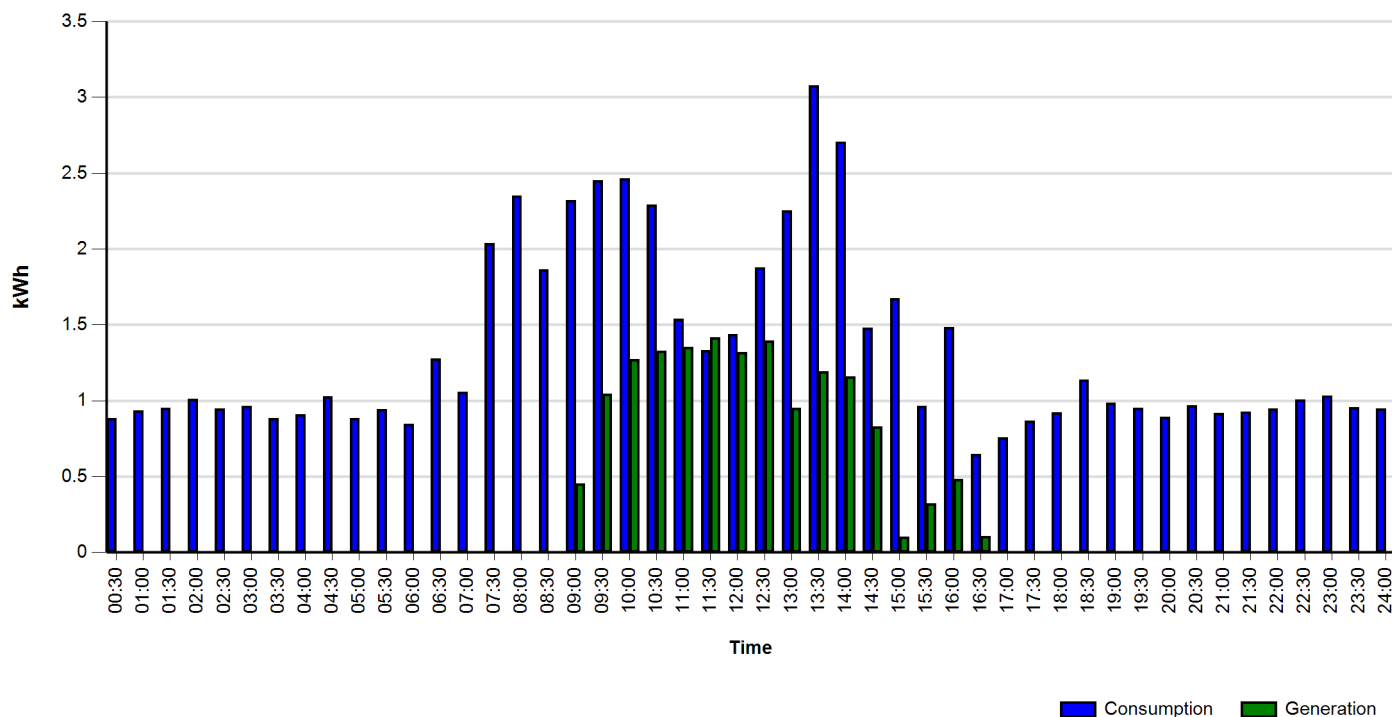

Total Consumption for this period: 63.984 kWh

Total Generation for this period: 14.728 kWh

S = Substituted Data E = Estimated Data

Half Hourly Ending	Quality	kWh Consumption	kWh Generation
00:30		0.884	0.000
01:00		0.936	0.000
01:30		0.952	0.000
02:00		1.012	0.000
02:30		0.948	0.000
03:00		0.964	0.000
03:30		0.884	0.000
04:00		0.908	0.000
04:30		1.028	0.000
05:00		0.884	0.000
05:30		0.944	0.000
06:00		0.844	0.000
06:30		1.276	0.000
07:00		1.056	0.000
07:30		2.036	0.000
08:00		2.352	0.004

Report Parameters

From: 19/10/2012 to 19/10/2012

Customer: DET NSSP

NMI(s): 4103795744

1708 Wisemans Ferry Rd, Central Mangrove

Meter(s): AMO002446

Time Zone: AEST

Half Hourly Ending	Quality	kWh Consumption	kWh Generation
08:30		1.864	0.000
09:00		2.320	0.452
09:30		2.452	1.044
10:00		2.464	1.272
10:30		2.292	1.328
11:00		1.540	1.352
11:30		1.332	1.416
12:00		1.436	1.320
12:30		1.876	1.396
13:00		2.252	0.952
13:30		3.076	1.192
14:00		2.704	1.160
14:30		1.480	0.828
15:00		1.676	0.100
15:30		0.964	0.320
16:00		1.484	0.484
16:30		0.648	0.108
17:00		0.756	0.000
17:30		0.868	0.000
18:00		0.924	0.000
18:30		1.136	0.000
19:00		0.984	0.000
19:30		0.952	0.000
20:00		0.892	0.000
20:30		0.968	0.000
21:00		0.916	0.000
21:30		0.928	0.000
22:00		0.948	0.000
22:30		1.008	0.000
23:00		1.032	0.000
23:30		0.956	0.000
24:00		0.948	0.000